


6"-14" Industrial Isolation Damper

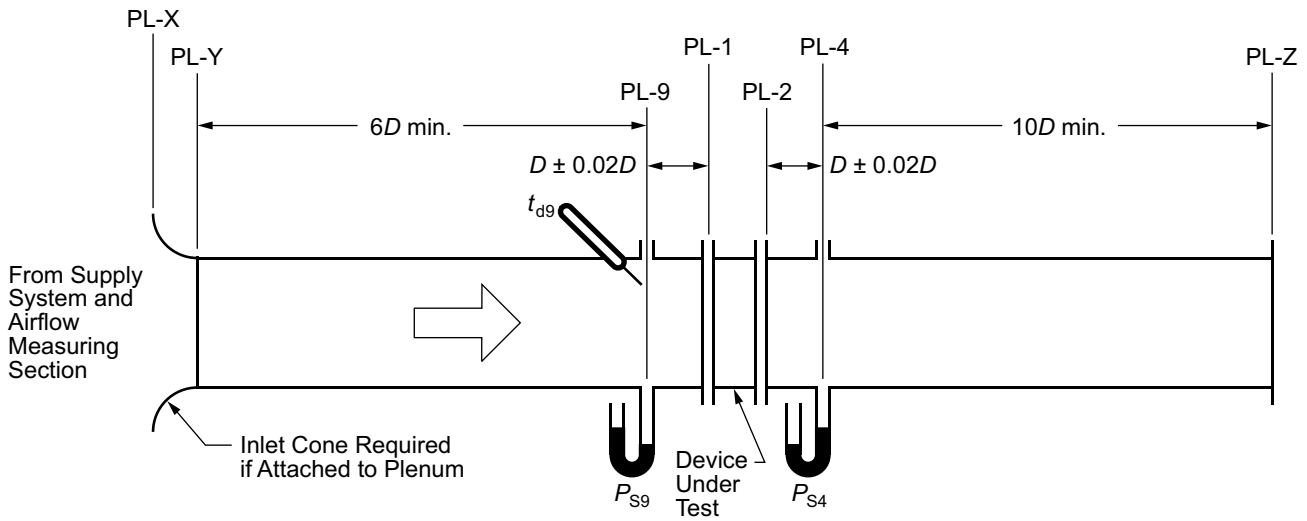

D = duct diameter for round ducts

Fig. 5.3: Test Damper Setup with Inlet and Outlet Ducts

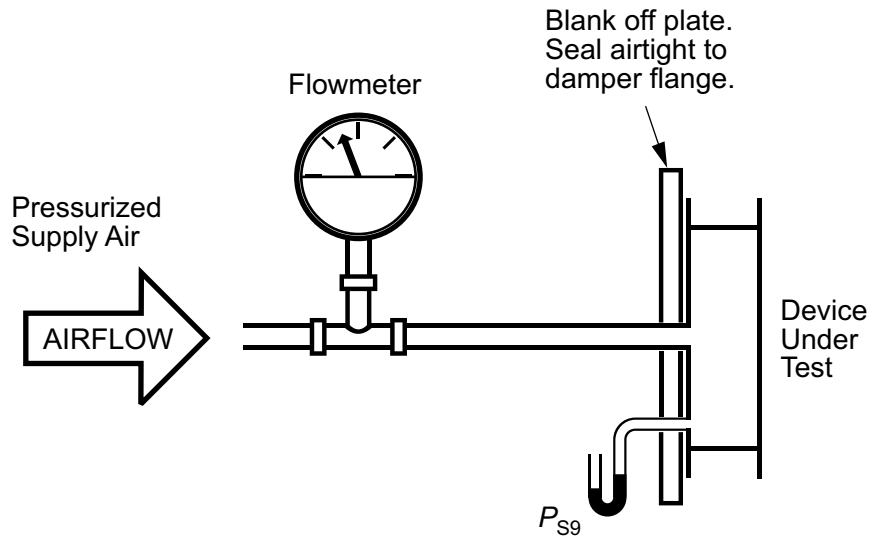


Fig. 5.6: Test Damper Setup - Leakage Test with Damper under Positive Pressure